

TRIMMED CABLES-COMPRESSION TYPE COPPER SLEEVE. (SIZED FOR ACTUAL NUMBER OF CABLES AND MFR. SUGGESTED CRIMP TOOL USED) HEAT-SHRINKABLE CAP WITH FACTORY APPLIED WATERPROOF SEALANT. (SIZED TO-ACCOMMODATE NUMBER OF CABLES). SEALANT TAPE OR INSERT. (AROUND AND THROUGH CROTCH OF SPLICE). *NOTE: THAT NUMBER OF CABLES IN SPLICE MAY VARY. ELECTRIC FEEDER CABLES, SUCH AS UNIT DUCT (SIZE AS NOTED ON CONTRACT DRAWINGS). EXPOSED SEALANT ELECTRIC CABLE TO LUMINAIRE (SIZE AS NOTED ELSEWHERE IN

SPLICING ELECTRIC CABLES

BASIC MATERIALS AND METHODS

THESE PLANS).

CONTROLLER WIRING DIAGRAM LEGEND

- 3-1/C, NO. 3/O, 600V SERVICE WIRE IN 2" DIA. GALVANIZED STEEL CONDUIT FOR 1 120/240 VOLT, 1ø, 3 WIRE, 60HZ. SERVICE.
- (1) 200 AMP MAIN CIRCUIT BREAKER, 2 POLE, 600 VOLT, 100 AMP BASE, NON-2 INTERCHANGEABLE TRIP INTERRUPTING RATING NEMA - 14000 AMP AT 480 V.
- (1) 200 AMP REMOTE CONTROL CONTACTOR SWITCH, ELECTRICALLY OPERATED, MECHANICALLY HELD, 2 POLE, 600 VOLT (3)
- 4 (4) 30 AMP CIRCUIT BREAKER, 1 POLE, 240 VOLT, 100 AMP BASE, NON-INTER-CHANGEABLE TRIP RATING NEMA - 14000 AMP AT 240 VOLTS.
- (5) (3) 20 AMP CONTROL CIRCUIT-CIRCUIT BREAKER, 1 POLE, 240 VOLT, 100 AMP BASE, NON-INTERCHANGEABLE TRIP INTERRUPTING RATING NEMA 14000 AMP AT 240 V.
- 6 (1) 20 AMP, 1 POLE DOUBLE THROW, 240 VOLT RELAY
- 8 (1) 20 AMP, 120 VOLT DUPLEX GFCI RECEPTACLE.
- (9) NEUTRAL BUS BAR, 1/4"x1"x12" LONG MOUNTED ON PANEL WITH TAPS.
- (10) 3 POSITION SELECTOR SWITCH
- SWITCH FOR LIGHTING FIXTURE MOUNTED IN BOX.
- 12 WEATHER-PROOF INCANDESCENT LIGHTING FIXTURE WITH 60 WATT, 120 V LAMP.
- (13) PHOTOCELL MOUNTED TO CABINET, 120 V.
- (14) NO.8 AWG INSULATED GROUND WIRE
- 15) IN-LINE FUSEHOLDER WITH FUSE AS NOTED IN FUSE TABLE
- (16) GROUND BUS BAR 1/4"x1"x12" LONG MOUNTED ON PANEL WITH TAPS.

E

(F)

(G)

CIRCUIT

CIRCUIT

CIRCUIT

CIRCUIT

- 17) LUMINAIRE, 250W HPS
- (18)
- \bigcirc CIRCUIT
- **B** CIRCUIT
- (c) CIRCUIT
- 0 CIRCUIT

GENERAL NOTES FOR CONTROL CABINET

- 2. ALL WIRING SHALL BE TAGGED WITH SELF-STICKING WIRE MARKERS.
- GROUND BUS TO BE COLOR CODED GREEN, NEUTRAL BUS WHITE, AND BONDED TO CABINET ENCLOSURE, BY LISTED PRESSURE CONNECTORS OR LISTED CLAMPS.
- 4. ALL INTERNAL CONTROLLER WIRING TO BE NO.12 AWG UNLESS OTHERWISE SPECIFIED
- 5. CABINET WIRING INSULATION TO BE TYPE XHHW OR APPROVED EQUAL


LIGHTING GENERAL NOTES

- 1. ALL WORK TO CONFORM TO THE NATIONAL ELECTRICAL CODE AND ANY APPLICABLE LOCAL CODES.
- 2. CONTRACTOR TO VERIFY LOCATION OF ALL UNDERGROUND UTILITIES BEFORE TRENCHING OR AUGERING.
- 3. BEFORE INSTALLING STANDARDS NEAR OVERHEAD FACILITIES CALL C.E. Co. FOR APPROVAL OF LOCATION.
- 4. FOR LOCATION OF EXISTING UNDERGROUND ELECTRICAL CABLE CALL C.E. Co
- 5. SIZE ALL CONDUIT AS SPECIFIED ON DRAWINGS.
- 6. CONTRACTOR SHALL TAKE ALL NECESSARY MEASURES TO RESTORE ANY SPECIALIZED LANDSCAPING (i.e. DECORATIVE ROCKS, SHRUBS, PLANTS, ECT.) OR SHALL REPLACE IT, THE COST OF WHICH SHALL BE CONSIDERED INCIDENTAL TO THE CONTRACT.
- CARE IS TO BE TAKEN AS NOT TO DAMAGE ANY OF THE EXISTING TRAFFIC SIGNAL CONDUIT, MAGNETIC DETECTORS AND EQUIPMENT. IF ANY OF THE TRAFFIC SIGNAL CONDUIT AND/OR EQUIPMENT IS DAMAGED. THE CONTRACTOR SHALL REPAIR AND/OR REPLACE THE CONDUIT AND/OR EQUIPMENT AT NO COST TO THE CITY OR STATE.
- 8. THE CONTRACTOR SHALL MAKE SPECIAL NOTE OF THE REQUIREMENT FOR BURIED WARNING TAPE, SPECIFIED AS PART OF "TRENCH AND BACK FILL FOR ELECTRICAL WORK". THE INSTALLATION OF THE TAPE SHALL BE INSPECTED AND APPROVED BY THE RESIDENT ENGINEER PRIOR TO BACKFILLING OR DURING PLOWING OPERATIONS, AS APPLICABLE.
- 9. THE CONTRACTOR WILL BE RESPONSIBLE FOR THE ESTABLISHMENT OF FINISHED GRADE. THE RESIDENT ENGINEER MAY ASSIST THE CONTRACTOR, AS APPLICABLE, BUT THE RESPONSIBILITY FOR CORDINATING THE FINISHED GRADE ELEVATION WITH THE TOP OF THE FOUNDATION HEIGHTS AND THE LIGHT SHALL REMAIN WITH THE CONTRACTOR.
- NO POLES SHALL BE ERECTED UNTIL THE RESPECTIVE FOUNDATIONS HAVE CURED, AS APPROVED BY THE ENGINEER.
- 11. THE CONTRACTORS SHALL MAKE SPECIAL NOTE OF THE REQUIREMENTS FOR WIRE MARKERS AND SHALL TAG ALL WIRE MARKERS AND SHALL TAG ALL WIRE ACCORDINGLY.
- 12. EQUIPMENT GROUND CONDUCTORS SHALL BE SPLICED AND BONDED AT EACH LIGHT POLE OR OTHER PIECE OF EQUIPMENT.
- 13. SPLICE IS NOT ALOWED IN THE HANDHOLE.
- 14. CONDUITS AND UNIT DUCTS MUST BE POSITIONED IN THE FIELD TO AVOID CONFLICT WITH TREE, BUSHES, DRAINS AND OTHER UTILITIES.
- 15. THE CONTROLLER SHALL BE SUITABLE FOR USE AS SERVICE ENTRANCE RATED.

F. A. P. RTE.	SECTION		COUNTY	TOTAL SHEETS	SHEET NO	
29	08-00055-00-LT		соок	012	009	
STA.	STA. TO STA.					
FED. ROAD DIST. NO. ILLINOI			S FED. AID PRO	OVECT		

CONTRACT #63028

NOMINAL WATTAGE FUSE SIZE **FESTOON** 6.0 AMP LUMINAIRE FUSE SIZE TABLE

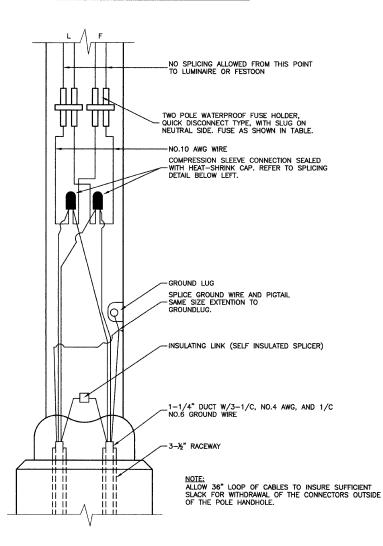

POLE HANDHOLE WIRING DIAGRAM (TYPICAL FOR SINGLE LUMINAIRE INSTALLATION)

> ILLINOIS DEPARTMENT OF TRANSPORTATION 95TH STREET STREET LIGHTING PLAN LIGHTING DETAILS SCALE: VERT. NA HORIZ. NA DATE 07/15/08 DRAWN BY AG CHECKED BY PAP