






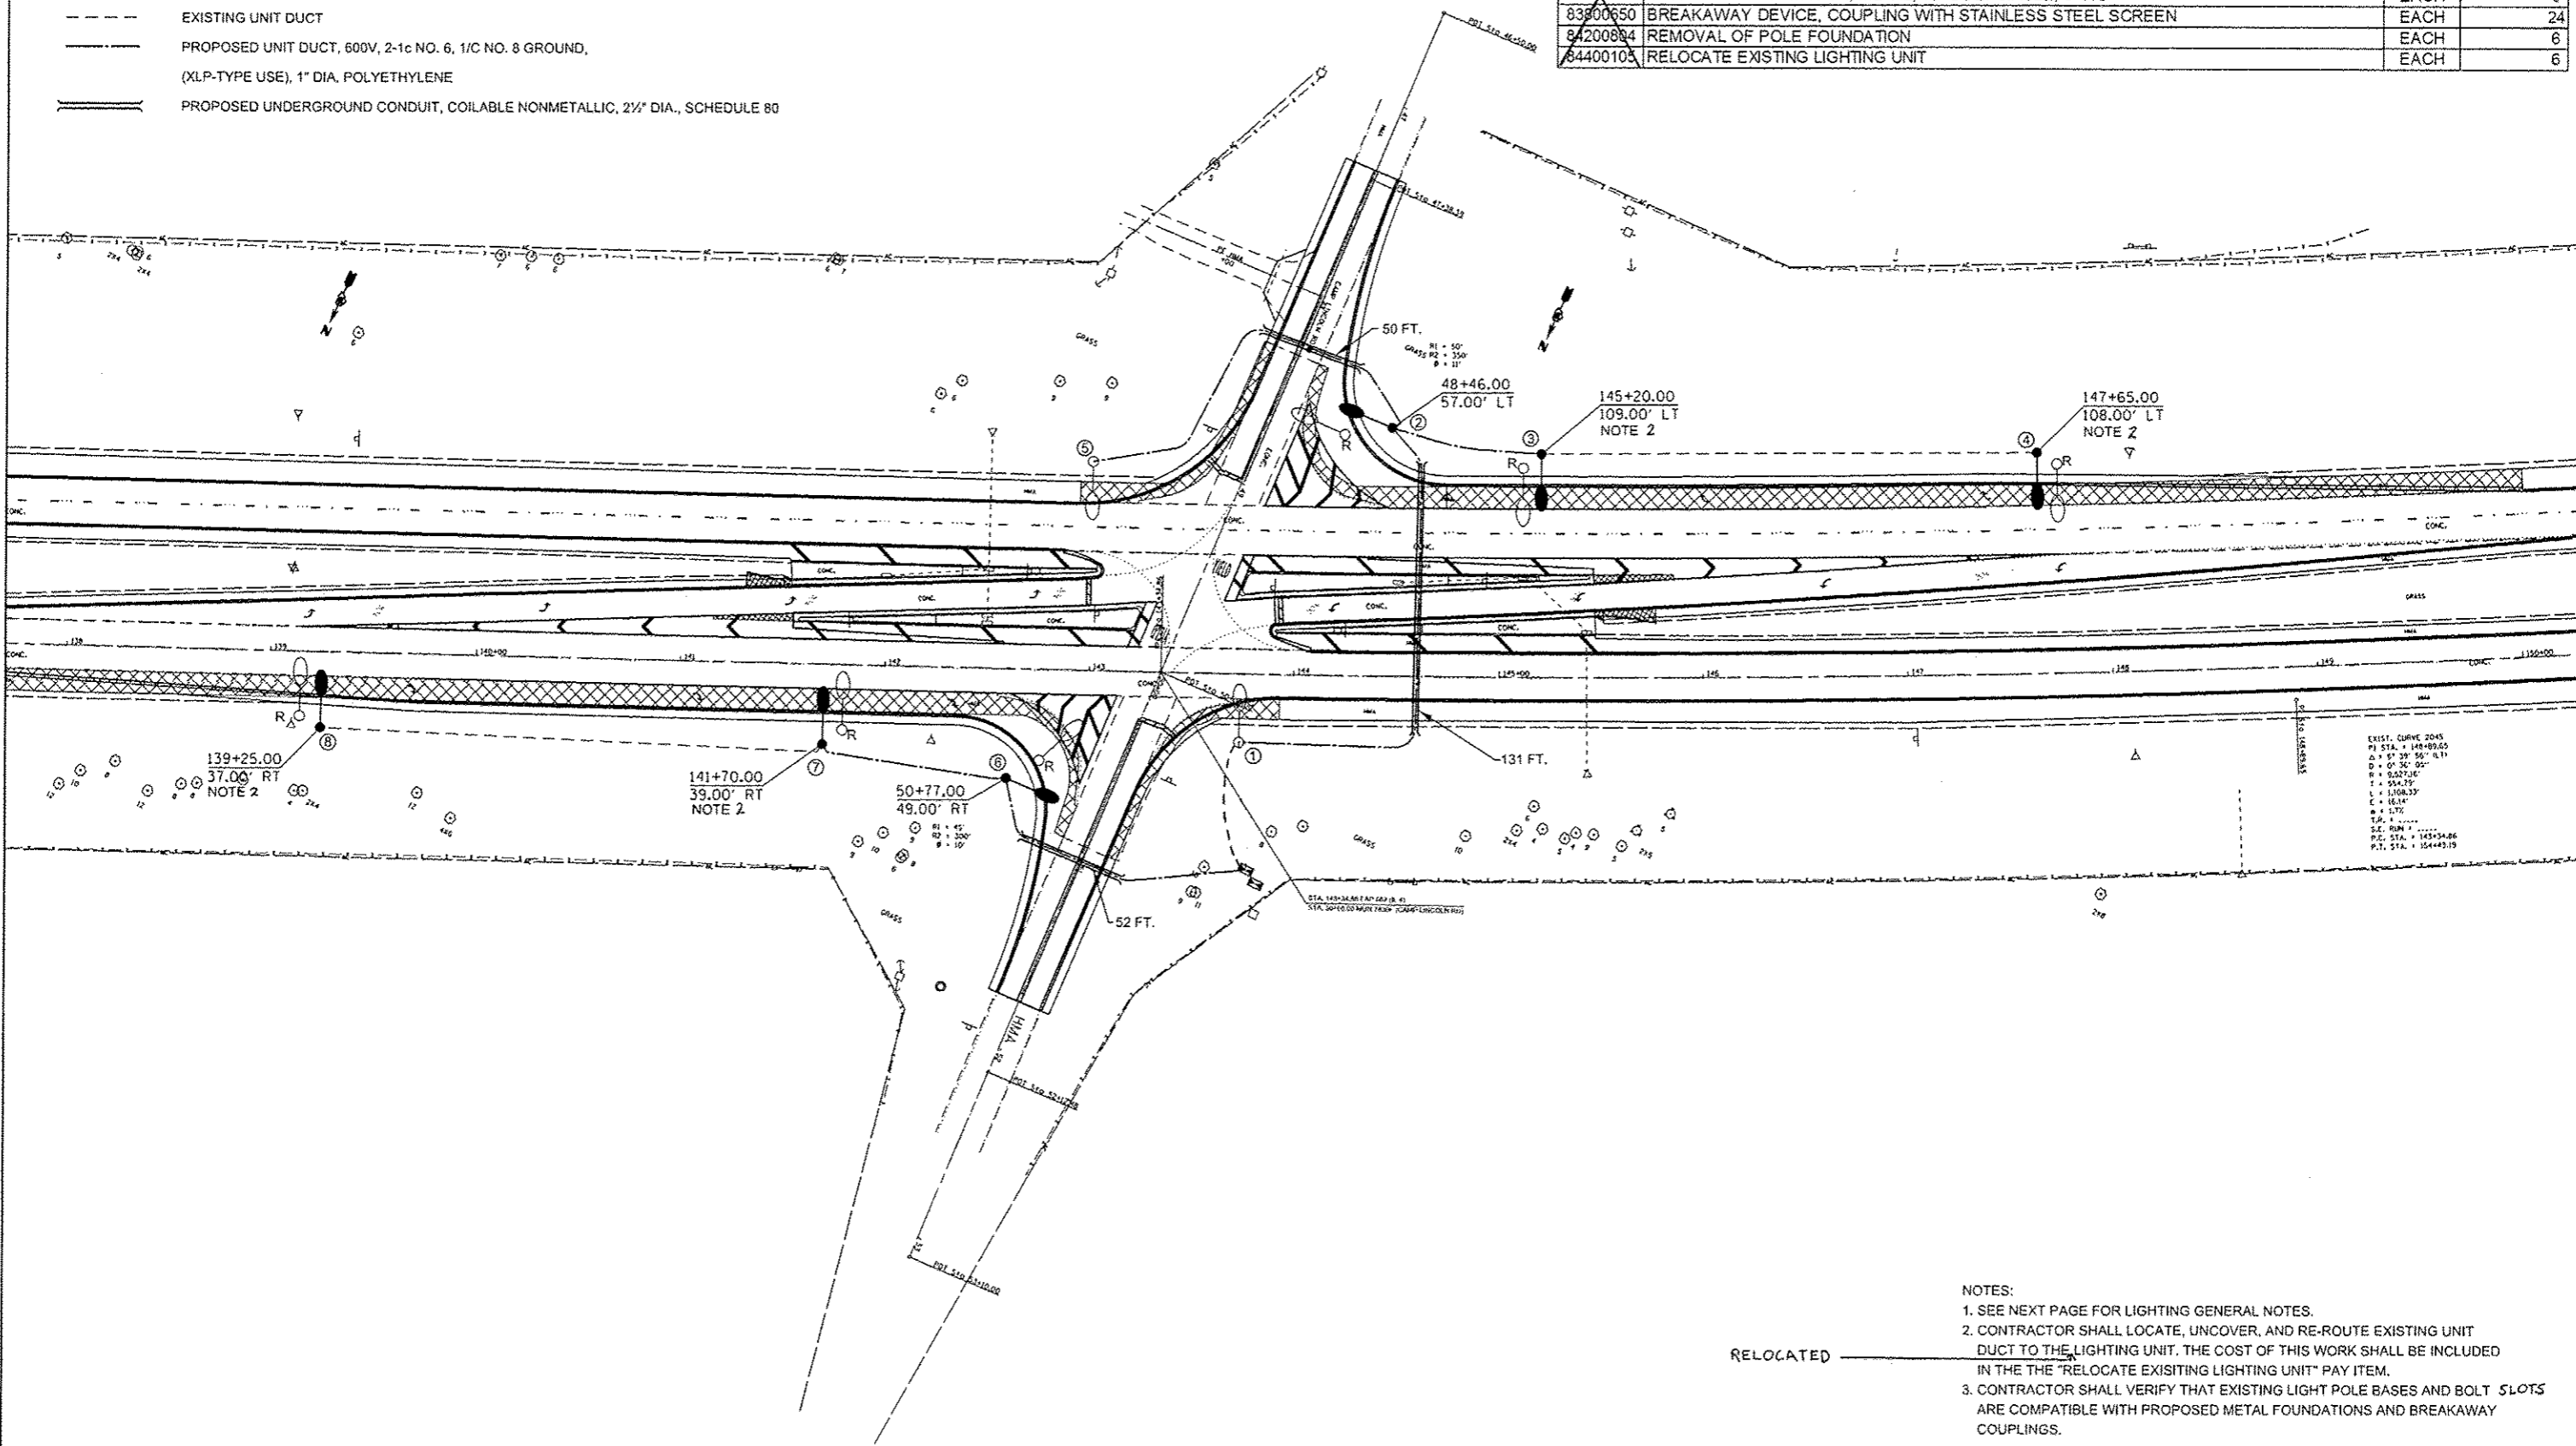


LEGEND

-  EXISTING LIGHTING UNIT TO REMAIN
-  EXISTING LIGHTING UNIT TO BE RELOCATED
-  RELOCATED LIGHTING UNIT
-  EXISTING LIGHTING CONTROLLER
-  EXISTING UNIT DUCT
-  PROPOSED UNIT DUCT, 600V, 2-1c NO. 6, 1/C NO. 8 GROUND, (XLP-TYPE USE), 1" DIA. POLYETHYLENE
-  PROPOSED UNDERGROUND CONDUIT, COILABLE NONMETALLIC, 2 1/2" DIA., SCHEDULE 80

BILL OF MATERIALS			
PAY ITEM	DESCRIPTION	UNIT	QUANTITY
81028750	UNDERGROUND CONDUIT, COILABLE NONMETALLIC CONDUIT, 2 1/2" DIA.	FOOT	233
81803840	UNIT DUCT, 600V, 2-1C NO.6, 1/C NO.8 GROUND, (XLP-TYPE USE), 1" DIA. POLYETHYLENE	FOOT	753
83600355	LIGHT POLE FOUNDATION, METAL, 15" BOLT CIRCLE, 8" X 6"	EACH	6
83900650	BREAKAWAY DEVICE, COUPLING WITH STAINLESS STEEL SCREEN	EACH	24
84200884	REMOVAL OF POLE FOUNDATION	EACH	6
84400103	RELOCATE EXISTING LIGHTING UNIT	EACH	6
		TOTALS	



- NOTES:**
- SEE NEXT PAGE FOR LIGHTING GENERAL NOTES.
 - CONTRACTOR SHALL LOCATE, UNCOVER, AND RE-ROUTE EXISTING UNIT DUCT TO THE LIGHTING UNIT. THE COST OF THIS WORK SHALL BE INCLUDED IN THE "RELOCATE EXISTING LIGHTING UNIT" PAY ITEM.
 - CONTRACTOR SHALL VERIFY THAT EXISTING LIGHT POLE BASES AND BOLT SLOTS ARE COMPATIBLE WITH PROPOSED METAL FOUNDATIONS AND BREAKAWAY COUPLINGS.