



CONTRACT NO. 60A65

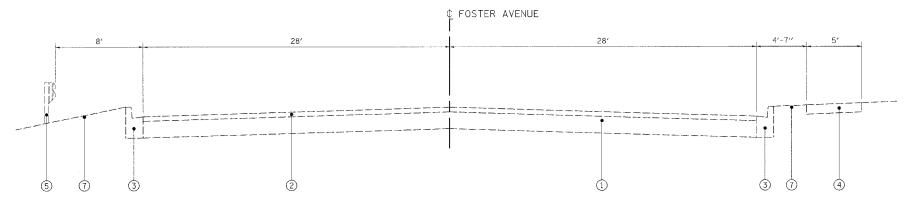


## **EXISTING TYPICAL SECTION**

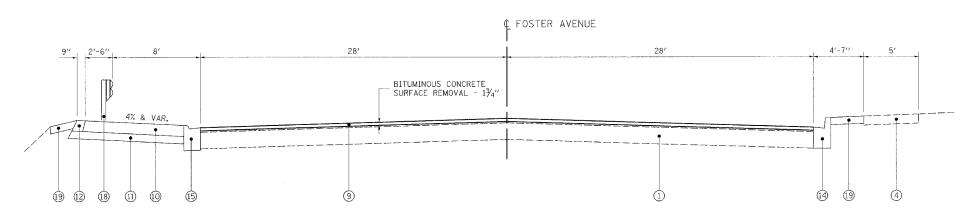

## PROPOSED RESURFACING

STA. 98+90.00 TO 98+96.00 STA. 100+98.00 TO 102+50.00

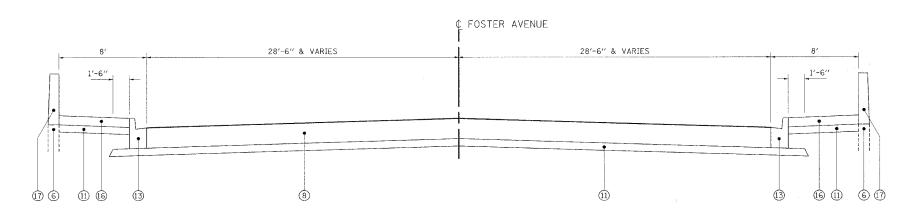

## PROPOSED RECONSTRUCTION

STA. 98+96.00 TO 99+12.00

THE FOLLOWING MIXTURE REQUIREMENTS ARE APPLICABLE FOR THIS PROJECT:

	BITUMINOUS CONCRETE	BITUMINOUS
	SURFACE COURSE,	SHOULDER
	SUPERPAVE MIX D, N50. 13/4"	SUPERPAVE, 6".
PG GRADE	PG 64-22	PG 58-22
MAX % RAP ALLOWABLE	15%	50%
DESIGN AIR VOIDS	4.0% @ 50 GYR	2.0% @ 30 GYR

THE UNIT WEIGHT USED TO CALCULATE ALL BITUMINOUS SURFACE MIXTURE QUANTITIES IS 112 POUNDS PER SQUARE YARD, PER INCH.

## LEGEND

- 1 EXISTING P.C.C PAVEMENT 9"
- 2 EXISTING BITUMINOUS SURFACE 21/2"
- 3 EXISTING COMBINATION CONCRETE CURB & GUTTER TYPE B-6.12
- 4 EXISTING P.C.C. SIDEWALK
- 5 EXISTING GUARDRAIL
- ⑥ EXISTING RETAINING WALL
- 7 EXISTING TOPSOIL
- 8 PROPOSED P.C.C. PAVEMENT 111/2"
- $\begin{tabular}{lll} \begin{tabular}{lll} \begin{$
- 10 PROPOSED BITUMINOUS SHOULDERS, SUPERPAVE, 6"
- 11) PROPOSED SUB-BASE GRANULAR MATERIAL, TYPE B 4"
- (12) PROPOSED AGGREGATE SHOULDERS, TYPE B
- (3) PROPOSED COMBINATION CONCRETE CURB & GUTTER TYPE B-9.12
- (4) PROPOSED COMBINATION CONCRETE CURB & GUTTER TYPE B-6.12
- (15) PROPOSED COMBINATION CONCRETE CURB & GUTTER TYPE M-2.12
- 16 PROPOSED P.C.C SIDEWALK, 5"
- 17 PROPOSED RETAINING WALL EXTENSION
- (8) PROPOSED STEEL PLATE BEAM GUARDRAIL
- (9) PROPOSED TOPSOIL, FURNISH AND PLACE, 4"

