


SECTION A-A

Note:
Existing reinforcement shall be cleaned and incorporated into the new construction. Cost included with Concrete Removal.

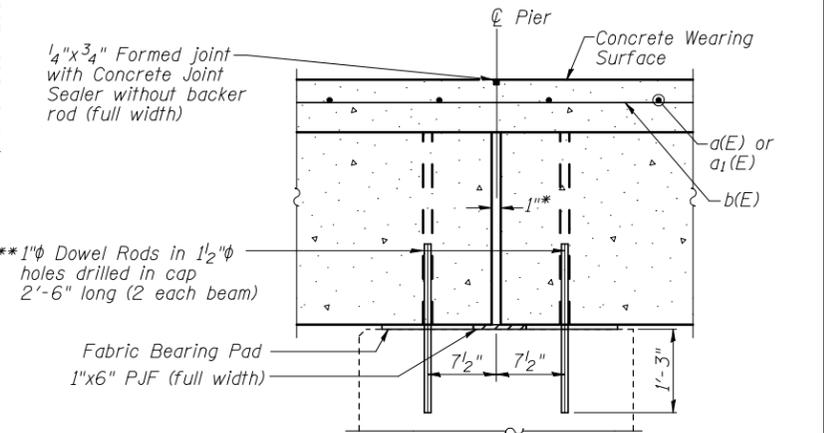


SECTION B-B

*1" Jt. shall be filled with non-shrink grout. 1" dimension may vary to accommodate tolerance in beam lengths.

**Prior to Grinding

***Existing dowel rods shall be cut off and ground flush to the top of the existing cap. Cost included with Removal of Existing Superstructure.

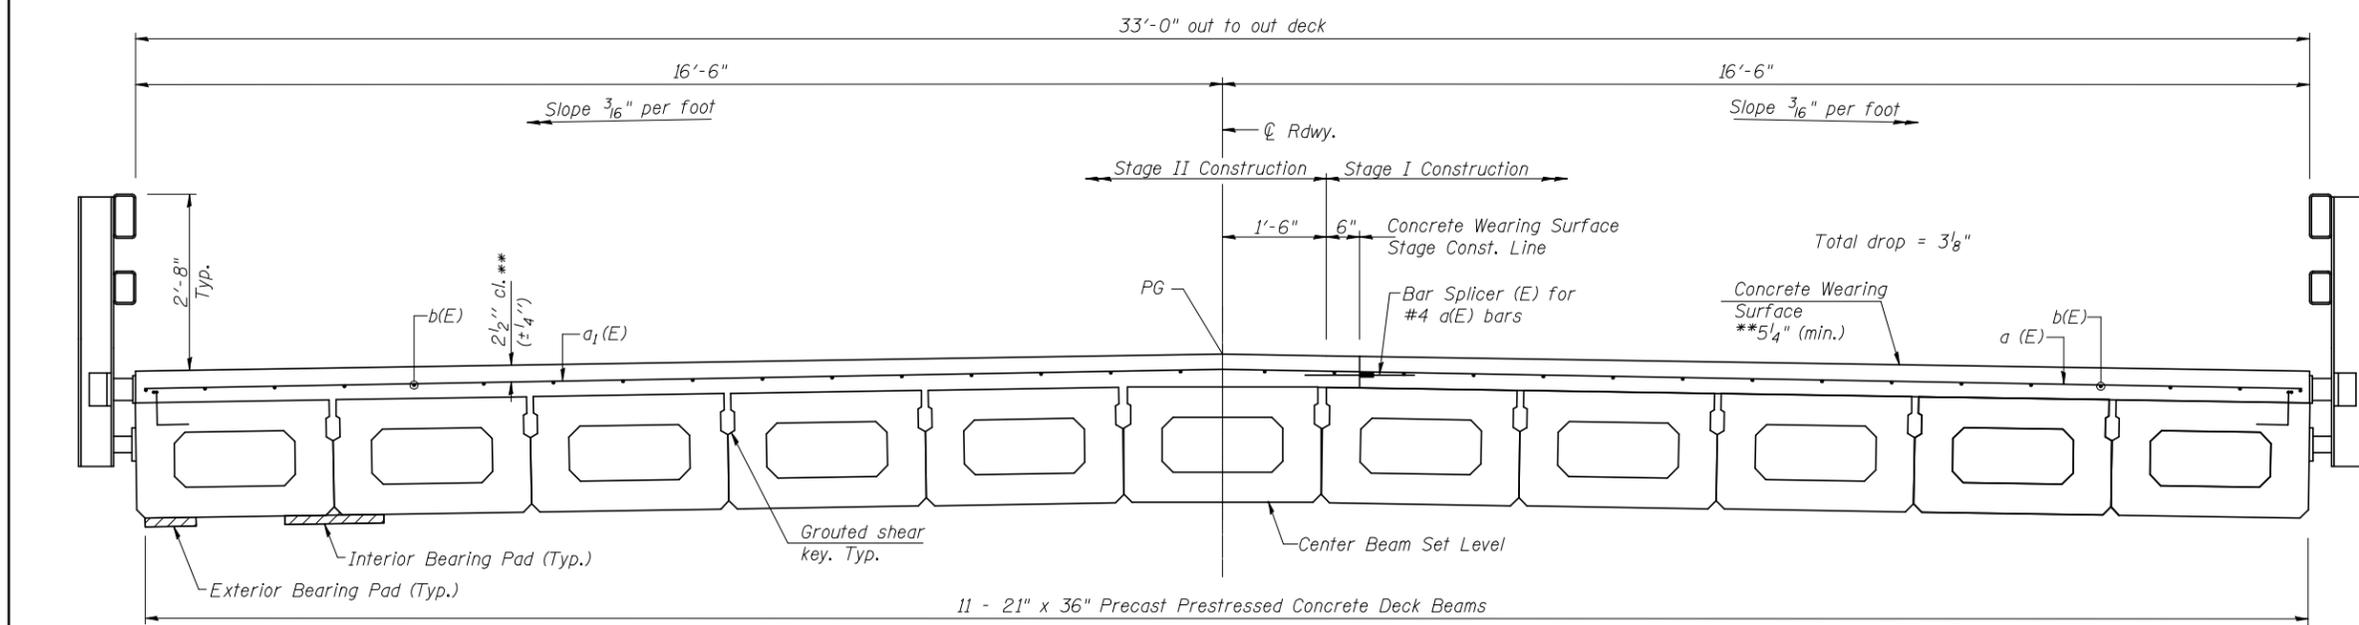

Notes:

See sheet 5 of 15 for Superstructure Details and Bill of Material.

Bars indicated thus 34 x 5-#4 etc. indicates 34 lines of bars with 5 lengths per line.

All concrete wearing surfaces shall be placed prior to casting hatch block.

See sheet 8 of 15 for fabric bearing pad details.

See sheet 6 of 15 for Steel Railing Details.