


no.	date	by	ckd	description
0	04/25/08	BJQ	MAR	ISSUED FOR BID



KEYMAP

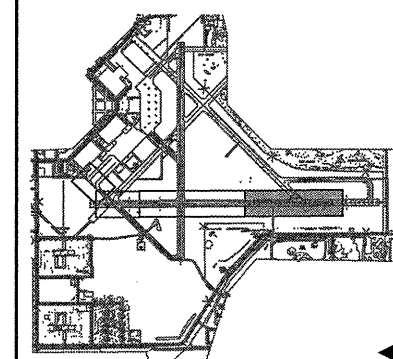

date	02/13/08	detailed	L. TUCKER
designed	B. QUINLAN	checked	A. RAHMAN


**RUNWAY 9/27 LIGHTING, NAVAIDS AND SIGNAGE; RUNWAY 18/36 WIND CONES AND SIGNAGE**

ELECTRICAL DEMOLITION PLAN  
RUNWAY 9-27 STA. 57+50 TO STA. 80+00



project	contract
---------	----------

drawing **D104** - rev. **0**

sheet 8 of 21 sheets  
file 47463D104.DWG

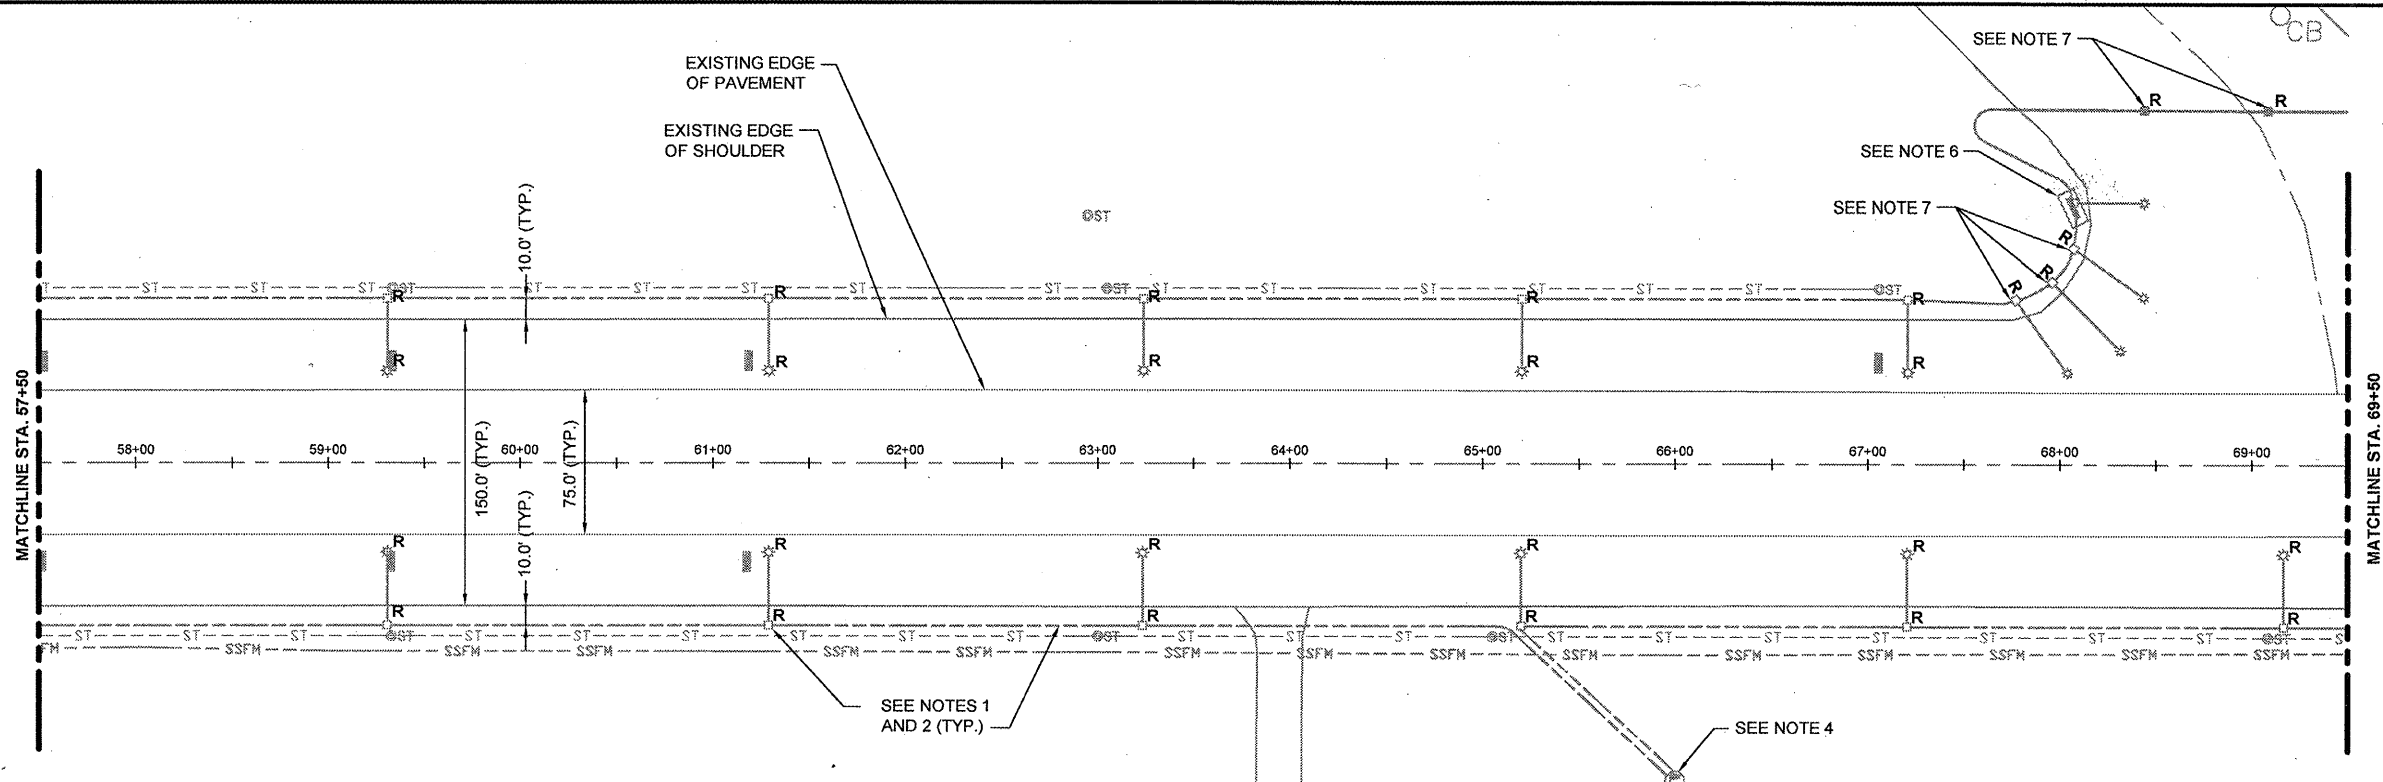

- NOTES:**
1. ALL WIRING AND UNIT DUCT BEING DISCONNECTED OR DECOMMISSIONED UNDER THIS PROJECT SHALL BE REMOVED FROM ALL CONDUITS, DUCT BANKS, HANDHOLES OR MANHOLES. DIRECT BURIED WIRING AND ASSOCIATED UNIT DUCT SHALL ALSO BE REMOVED AND REPLACED WITH NEW WIRING IN UNIT DUCT.
  2. RUNWAY 9/27 WIRING (IN UNIT DUCT), ISOLATION TRANSFORMERS, SPLICES, LIGHTS, BASE CANS, LIGHT STAKES, COUNTERPOISE AND SAFETY GROUND SYSTEM TO BE REMOVED AND REPLACED IN ITS ENTIRETY.
  3. NOTE NOT USED.
  4. EXISTING WIND CONE SOCK TO BE REMOVED AND REPLACED. EXISTING 5KV WIRING, POWER ADAPTOR AND BASE CAN TO BE DISCONNECTED AND REMOVED. EXISTING GROUND ROD TO REMAIN IN PLACE.
  5. EXISTING REIL SYSTEM TO BE REMOVED. THIS SHALL INCLUDE MASTER REIL, SLAVE REIL, GROUNDING SYSTEM, 5KV WIRING, CONTROL WIRING AND CONCRETE BASES. AREA TO BE REGRADED OR REPAIRED TO MATCH SURROUNDING FINISHED GRADE. OLD EQUIPMENT SHALL BE RETURNED TO THE OWNER UNLESS DIRECTED OTHERWISE.
  6. EXISTING 5KV WIRING, ISOLATION TRANSFORMER AND SPLICES TO BE REMOVED AND REPLACED. EXISTING SIGN AND BASE TO REMAIN.
  7. EXISTING 5KV WIRING, ISOLATION TRANSFORMER AND SPLICES TO BE REMOVED AND REPLACED. EXISTING LIGHT FIXTURE AND STAKE OR BASE CAN TO REMAIN.

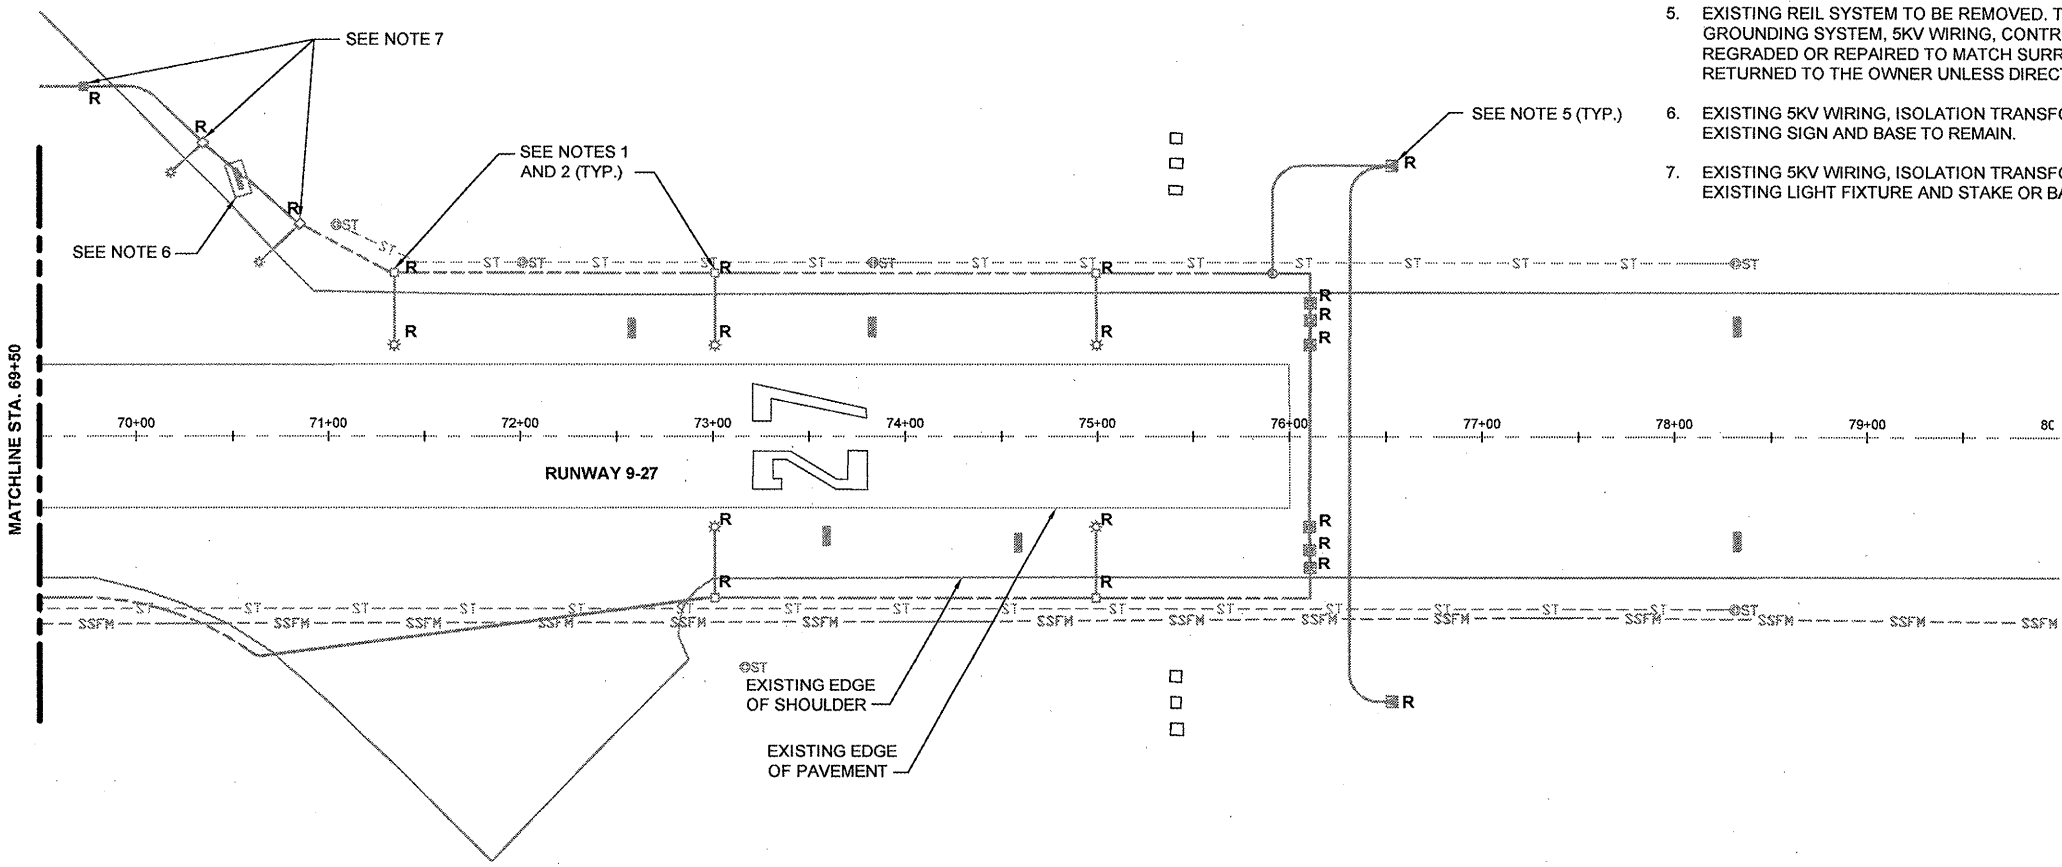

Scale For Microfilming

Inches

COPYRIGHT © 2008 BURNS & MCDONNELL ENGINEERING COMPANY, INC.