
F. A. RTE.	SECTIO	ON .	COUNTY	YOTAL SHEETS	SHEET
				907	802
STA.		T	STA.		
FED. ROA	D DIST. NO. 7	JULIMOSS	P	ED. AND PROJECT	

LIGHT TOWER FOUNDATION DEPTH "D"

MOUNTING HEIGHT	SOIL CONDITIONS								
	SOFT CLAY Qu = 0.375 TON/SQ. FT	MEDIUM CLAY Qu = 0.75 TON/SQ. FT	STIFF CLAY Qu = 1.50 TON/SQ. FT	LOOSE SAND Ø = 34°	MEDIUM SAND Ø = 37.5°	DENSE SAND Ø = 40°			
27m	8.779m	6.035m	4.389m	4.389m	3.840m	3.429m			
(90 ft)	(29 f†)	(20 ft)	(15 ft)	(15 f+)	(13 f†)	(12 ft)			
30m	9.754m	6.706m	4,877m	4.877m	4.267m	3.81m			
(100 f†)	(32 f†)	(22 ft)	(16 f†)	(16 ft)	(14 f†)	(13 ft)			
33m	10.719m	7.377m	5.365m	5.365m	4.694m	4.191m			
(110 ft)	(35 ft)	(24 ft)	(18 f†)	(18 ft)	(15 ft)	(14 ft)			
36m	11.705m	8.046m	5.652m	5.652m	5.120m	4.572m			
(120 ft)	(38 ft)	(26 ft)	(19 ft)	(19 f+)	(17 ft)	(16 ft)			

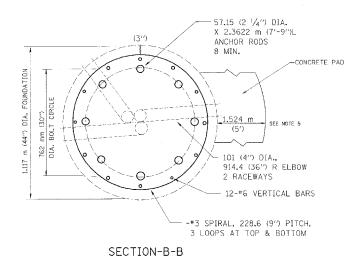

WITH REMOVABLE FLUSH COVER. COVER SHALL BE ATTACHED VIA S.S. HEADED SCREWS. OF THE STONE HED STONE

GROUND WELL DETAIL

-16 (5/8") DIA. x 3.048 m (10")

COPPER CLAD

MECHANICAL CONNECTION TO ANCHOR RODS EXOTHERMIC WELD CONNECTION TO REINFORCING STEEL EXOTHERMIC WELD CONNECTION EXOTHERMIC WELD CONNECTION EXOTHERMIC WELD CONNECTION SEE ANCHOR BOLT CASE WELDMENT DETAIL SHEET 2 ### A 27 SAME COPPER WIRE (SEE GROUND ROD DETAIL) SEE ANCHOR BOLT CASE WELDMENT DETAIL SHEET 2

BASE PLATE

304.8 (12") RACEWAY PROJECTION


76.2 (3")

1,117 m (44") FOUNDATION

ELEVATION

DESIGN NOTES

- (1) ALL DIMENSIONS IN MILLIMETERS (INCHES) UNLESS OTHERWISE SHOWN
- (2) THE HOLE FOR THE FOUNDATION SHALL BE ACCORDING
- (3) THE ANCHOR RODS SHALL BE VERTICAL NO ADJUSTMENT SHALL BE ALLOWED AFTER THE FOUNDATION IS PLACED.
- (4) THE GAP BETWEEN THE FOUNDATION AND THE BASE PLATE SHALL BE ENCLOSED WITH A STAINLESS STEEL SCREEN FASTENED WITH A STAINLESS STEEL BAND.
- (5) THE TOP OF THE FOUNDATION TO 450 (18") BELOW GRADE SHALL BE FORMED.
- (6) A CONCRETE WORK PAD SHALL BE PROVIDED AS INDICATED IN THE PLANS AS A PART OF THIS ITEM.
- (7) SURFACE WATER WILL NOT BE PERMITTED TO ENTER THE HOLE AND ALL WATER WHICH MAY HAVE INFILTRATED INTO THE HOLE SHALL BE REMOYED BEFORE PLACING CONCRETE.
- (8) THE LIGHT TOWER SHALL NOT BE ERECTED UNTIL AFTER THE CONCRETE HAS BEEN CURED ACCORDING TO ARTICLE 1020.13.
- (9) ANCHOR RODS SHALL BE STRAIGHT AND SHALL BE ACCORDING TO AASHTO M 314 OR ASTM F1554, GRADE 725(GRADE 105) AND GALVANIZED ACCORDING TO ARTICLE 1006.9.
- (IO) ANCHOR ROD INFORMATION SHALL BE SUBMITTED FOR APPROVAL AND SHALL BE FULLY COORDINATED FOR APPROVAL WITH TOWER MANUFACTURER REQUIREMENTS.
- (II) REINFORCEMENT BARS SHALL BE ACCORDING TO ARTICLE 1006.10
- (12) TWO ANCHOR RODS OPPOSITE EACH OTHER SHALL
 HAVE THE ANCHOR ROD THREADS PEENED AFTER NUTS
 ARE INSTALLED.

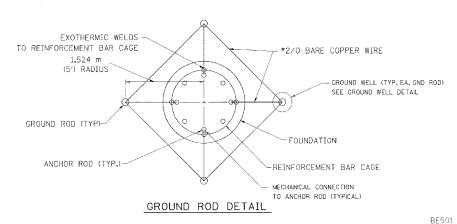

REVISIONS

NAME

DATE

TILLINOIS DEPARTMENT OF TRANSPORTATION

HIGH MAST LIGHT TOWER

27m TO 36m (90FT TO 120FT)

FOUNDATION DETAIL

SHEET 1 OF 2

SCALE: NONE
DATE 10/18/2002

CHECKED BY

REVISION DATE: G4/22/02

*DATE-TIM *DGN-SPEC