




ELECTRICAL SERVICE - PANEL DIAGRAM (TYPICAL FOR POLE AND GROUND MOUNTED SERVICE)


(NOT TO SCALE)

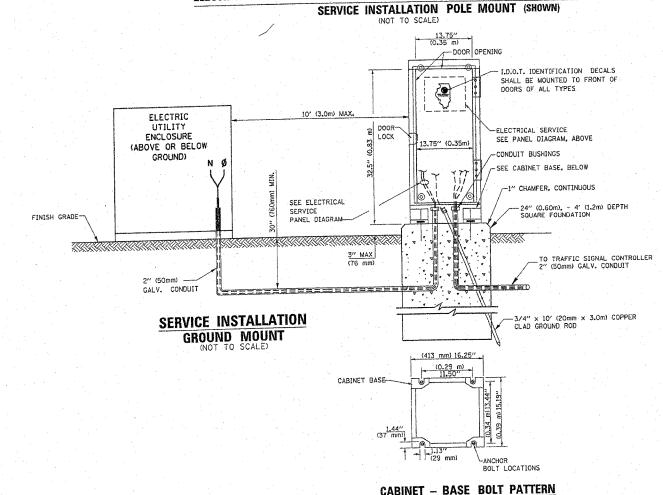

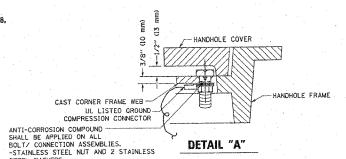



DETAIL "B"

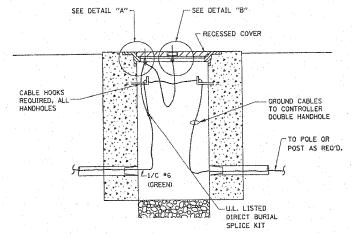

## HANDHOLE COVER & FRAME - GROUNDING DETAIL

(NOT TO SCALE

(2) 1/2" × 1 1/4" STAINLESS STEEL BOLT WITH SPLIT LOCK
WASHER AND NYLON INSERT LOCKOUT WELDED TO
FRAME AND TO COVER. (TYPICAL)

HEAVY DUTY COPPER COMPRESSION
GROUNDING TERMINAL. (TYPICAL)


EXISTING HANDHOLE
FRAME AND COVER (PAID FOR SEPARATELY)

EXISTING HANDHOLE COVER & FRAME - GROUNDING DETAIL

(NOT TO SCALE)

NOTES:

## GROUNDING SYSTEM



CONTRACT No.: 62739

- 1. THE GROUNDING SYSTEM SHALL CONSIST OF AN INSULATED CONDUCTOR

  TYPE XLP, NO. 6 A.W.G., STRANDED COPPER TO BE INSTALLED IN

  RACEWAYS. THE GROUNDING CABLE SHALL BE INSTALLED

  IN A CONTINUOUS MANNER AS SHOWN ON THE CABLE PLAN PROVIDED.

  ALL GROUNDING CONDUCTORS SHALL BE BONDED TO METAL ENCLOSURE

  (HANDHOLE, POST, MAST ARM, CONTROLLER, ETC.). GROUND ROD SHALL BE

  3/4" DIA. × 10'-0" (20mm × 3.0m) LONG, COPPER CLAD. ONE GROUND ROD

  SHALL BE INSTALLED AT ALL POST FOUNDATIONS, POLE FOUNDATIONS,


  CONTROLLER CABINET FOUNDATION AND ELECTRICAL SERVICE INSTALLATION


  AS INDICATED ON THE CABLE PLAN. IF THERE ARE ANY SPECIAL CONDITIONS

  SUCH AS SUB-SURFACE CONDITIONS OR INSTALLATION PROBLEMS. THE RESIDENT

  ENGINEER SHALL BE NOTIFIED OR CONTACT THE BUREAU OF TRAFFIC,

  ILLINOIS DEPARTMENT OF TRANSPORTATION DISTRICT ONE AT
- THE NEUTRAL CONDUCTOR AND THE GROUND CONDUCTOR SHALL BE CONNECTED IN THE SERVICE INSTALLATION. AT NO OTHER POINT IN THE TRAFFIC SIGNAL SYSTEM SHALL THE NEUTRAL AND GROUND CONDUCTORS BE CONNECTED.
- 3. ALL EQUIPMENT GROUNDING CONDUCTORS SHALL TERMINATE AT THE GROUND BUS IN THE CONTROLLER CABINET.
- 4. THE CONTRACTOR SHALL PROVIDE A GROUND CABLE WITH CONNECTORS BETWEEN THE HANDHOLE COVER AND HANDHOLE FRAME.








3/4" (20mm) HEAVY-DUTY GROUND ROD CLAMP (BURNDY TYPE GRC OR APPROVED EUAL)

## NOTES:

ALL CLAMPS SHALL BE BRONZE OR COPPER, UL APPROVED.
GROUND CABLE SHALL BE LOOPED OVER HOOKS IN THE HANDHOLES
6.5' (2.0m) SLACK SHALL BE PROVIDED IN SINGLE HANDHOLES
(4.0m) OF SLACK SHALL BE PROVIDED BETWEEN FRAME AND COVER.

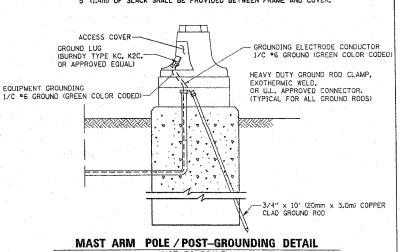

WOT TO SERLET	
REVISIONS	ILLINOIS DEPARTMENT OF TRANSPORTATION
NAME DATE	TELINOIS DELANTMENT OF TRANSPORTATION
	DISTRICT 1
	STANDARD TRAFFIC SIGNAL DESIGN DETAILS
	SCALE: VERT. NONE DESIGNED BY: DAD HORIZ. NONE DESIGNED BY: DAD CHECKED BY: DAZ DATE 1-01-02 SHEET 3 OF 4

TS05