


ITEMS

- (A) LIGHTNING ARRESTERS
- (B) MAIN CIRCUIT BREAKER - MOLDED CASE, THERMAL MAGNETIC, 2-POLE, 600V. A.C., 150 AMP FRAME, 150A. NON-INTERCHANGABLE TRIP, BOLT-ON TYPE, INTERRUPTING CAPACITY OF NOT LESS THAN 22,000 RMS SYMMETRICAL AMPERES AT 480V.
- (C) PHOTOCELL
- (D) TWO CHANNEL ASTRONOMICAL CLOCK
- (E) SELECTOR SWITCH
- (F) CONTROL CONTACTOR; 100 AMP, TWO POLE
- (G) CONTROL CONTACTOR; 60 AMP, TWO POLE
- (H) BRANCH CIRCUIT BREAKER, MOLDED CASE, THERMAL MAGNETIC, 2-POLE, 240V. BOLT-IN TYPE 20A. WITH AN INTERRUPTING RATING OF NOT LESS THAN 22,000 RMS SYMMETRICAL AMPERES AT 240V.
- (I) BRANCH CIRCUIT BREAKER, MOLDED CASE, THERMAL MAGNETIC, 1-POLE, 120V., BOLT-ON TYPE, 20A. WITH AN INTERRUPTING RATING OF NOT LESS THAN 10,000 RMS SYMMETRICAL AMPERES AT 120V.
- (J) CIRCUIT BREAKER, MOLDED CASE, THERMAL MAGNETIC, 1-POLE, 120V., BOLT-ON TYPE, 20A. WITH AN INTERRUPTING RATING OF NOT LESS THAN 10,000 RMS SYMMETRICAL AMPERES AT 120V.
- (K) NEUTRAL BUS BAR
- (L) GROUND BUS BAR
- (M) CABINET LIGHT, 60 WATT INCANDESCENT
- (N) CABINET LIGHT SWITCH
- (O) GFCI DUPLEX OUTLET

SEE CONTROLLER 1 DETAIL
FOR CABINET AND
FOUNDATION DETAILS

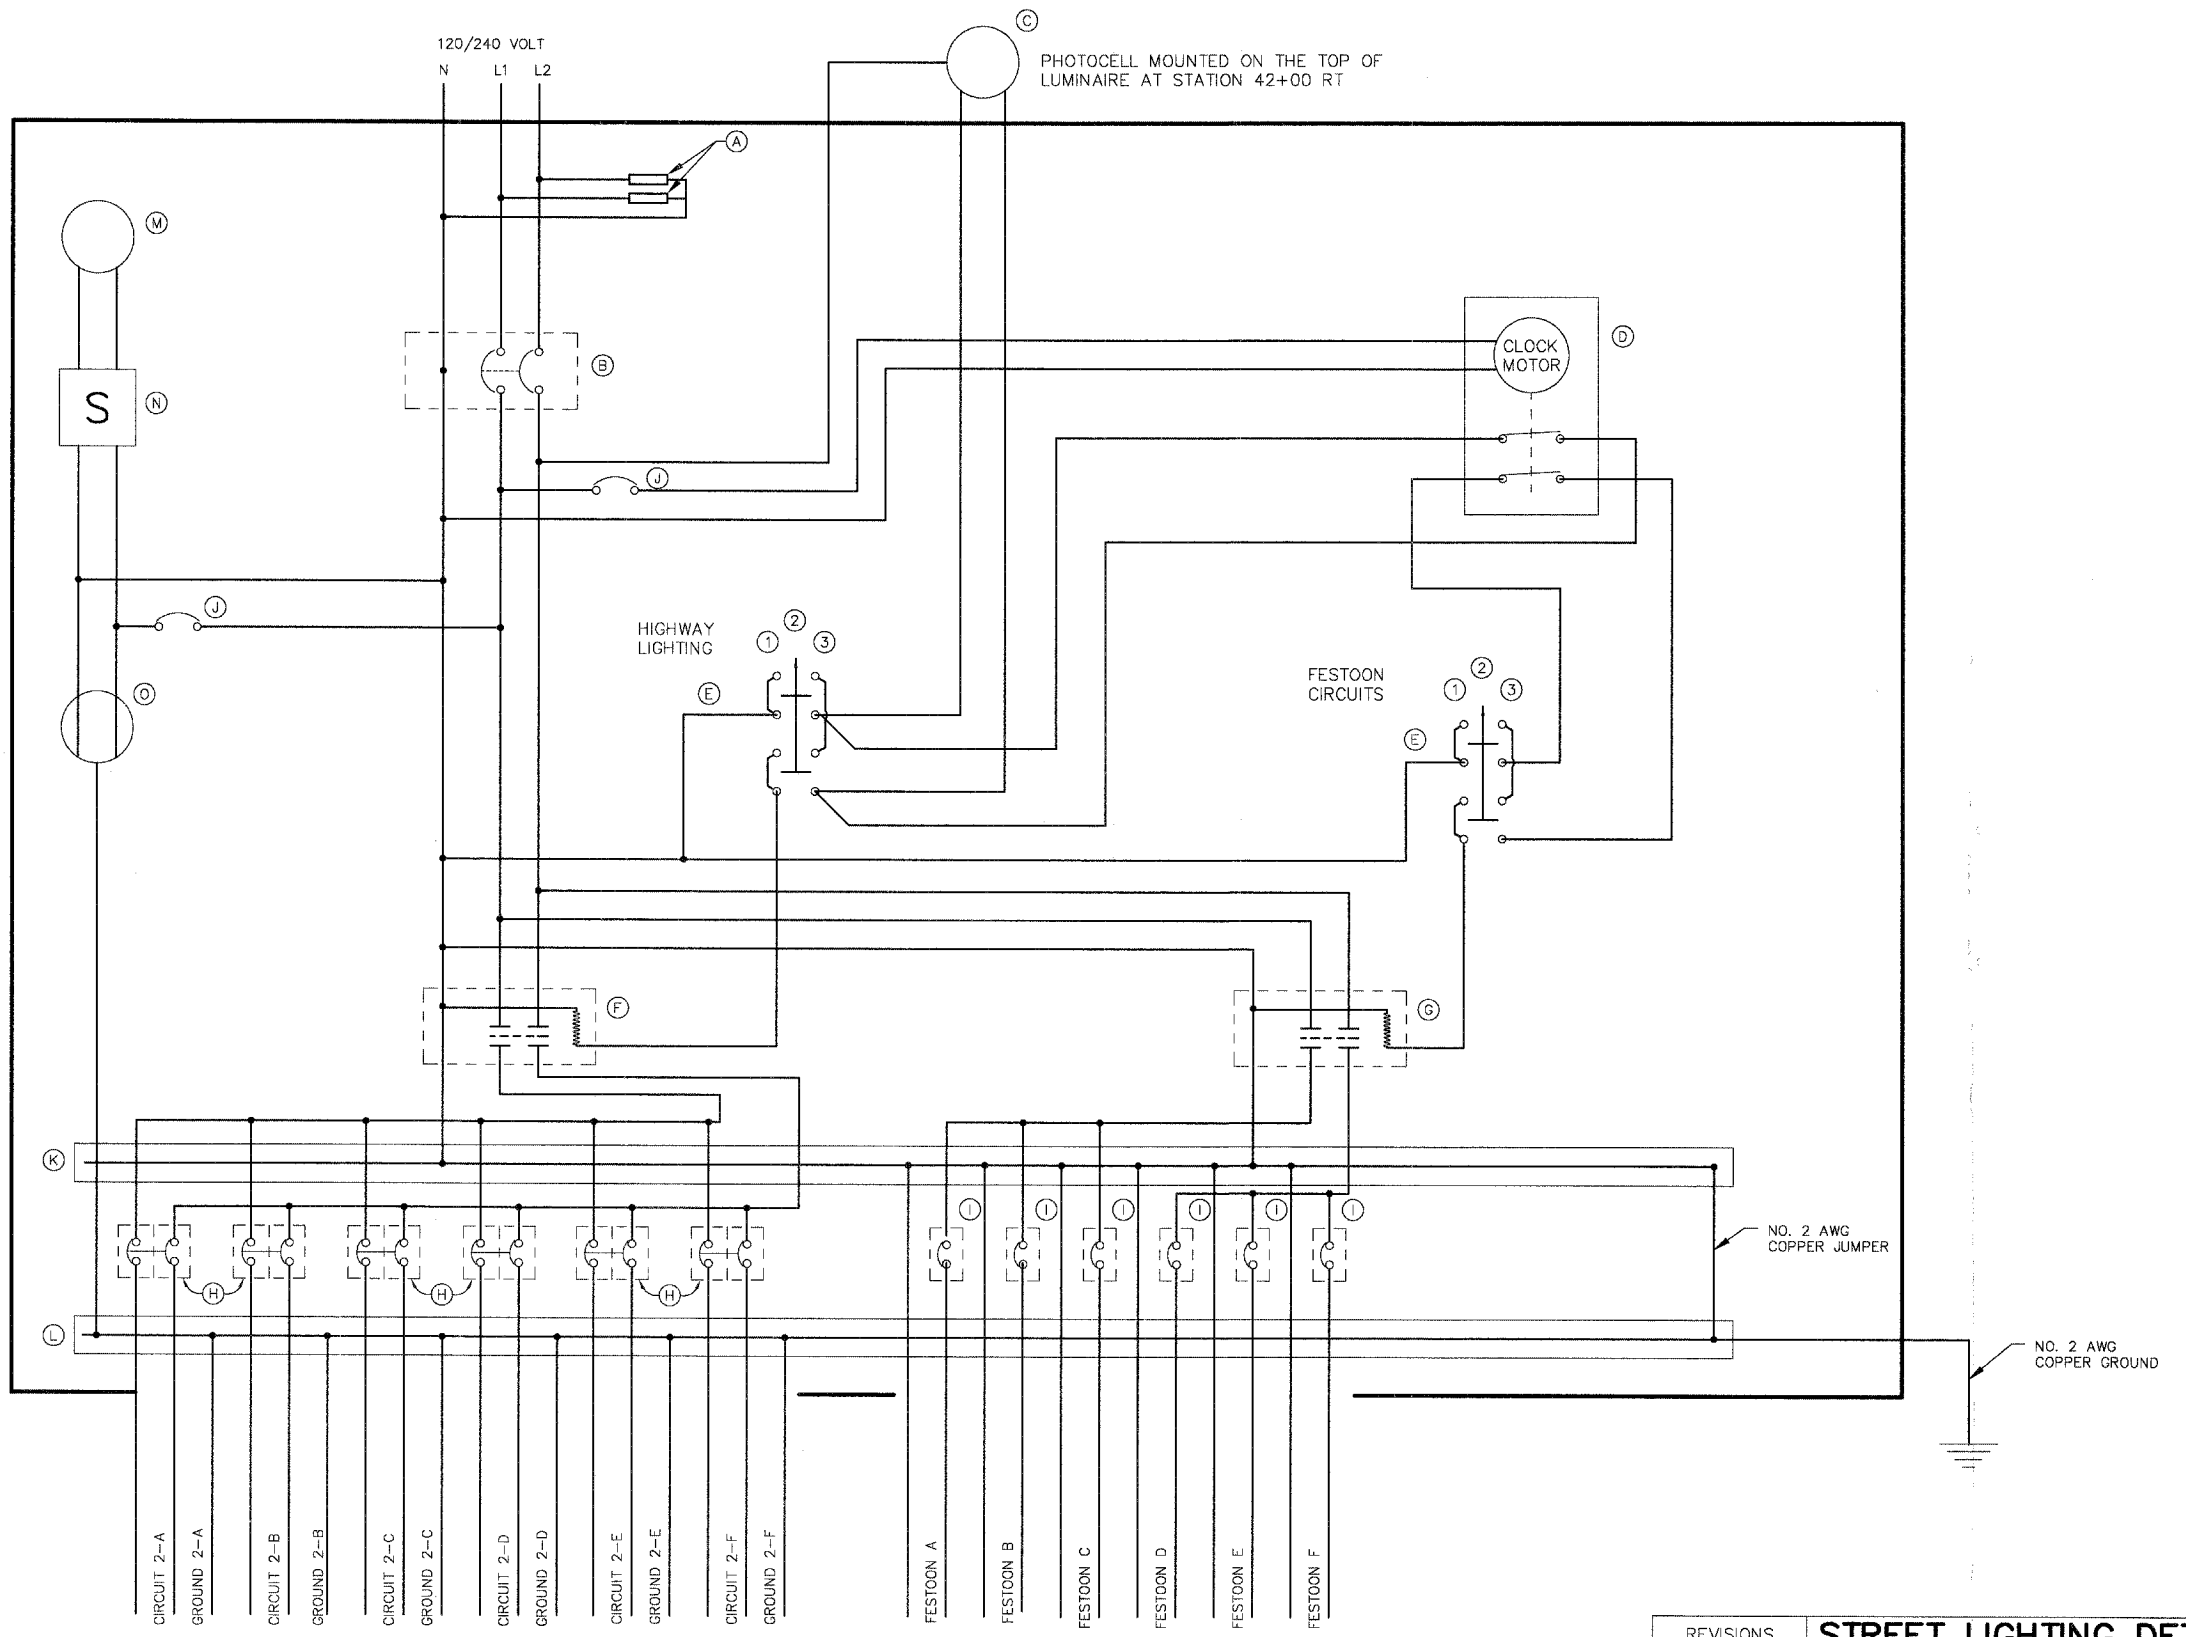

REVISIONS	
NAME	DATE
PER BEO	10-7-04
REVIEW	12-29-04

STREET LIGHTING DETAILS

CONTROL INSTALLATION, SPECIAL
CONTROLLER 2

RANDALL ROAD

SCALE: NONE DRAWN BY: JMH
DATE: 5-26-04 CHECKED BY: DAY