
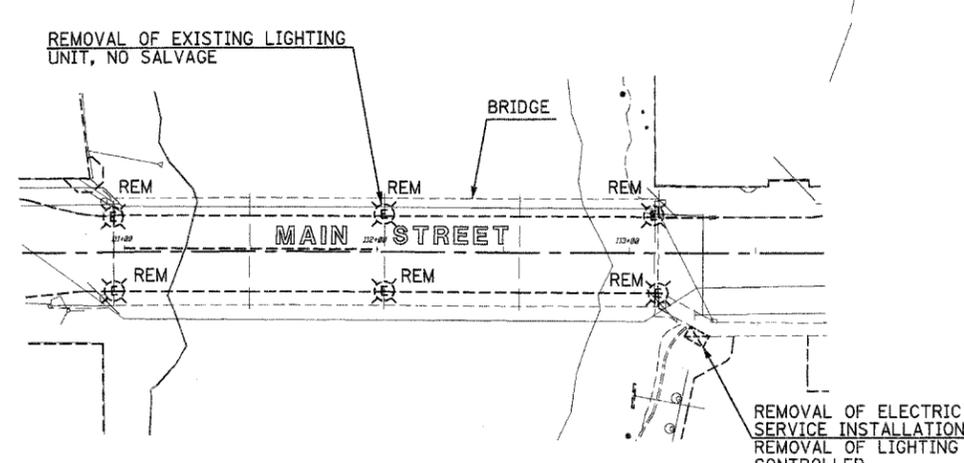
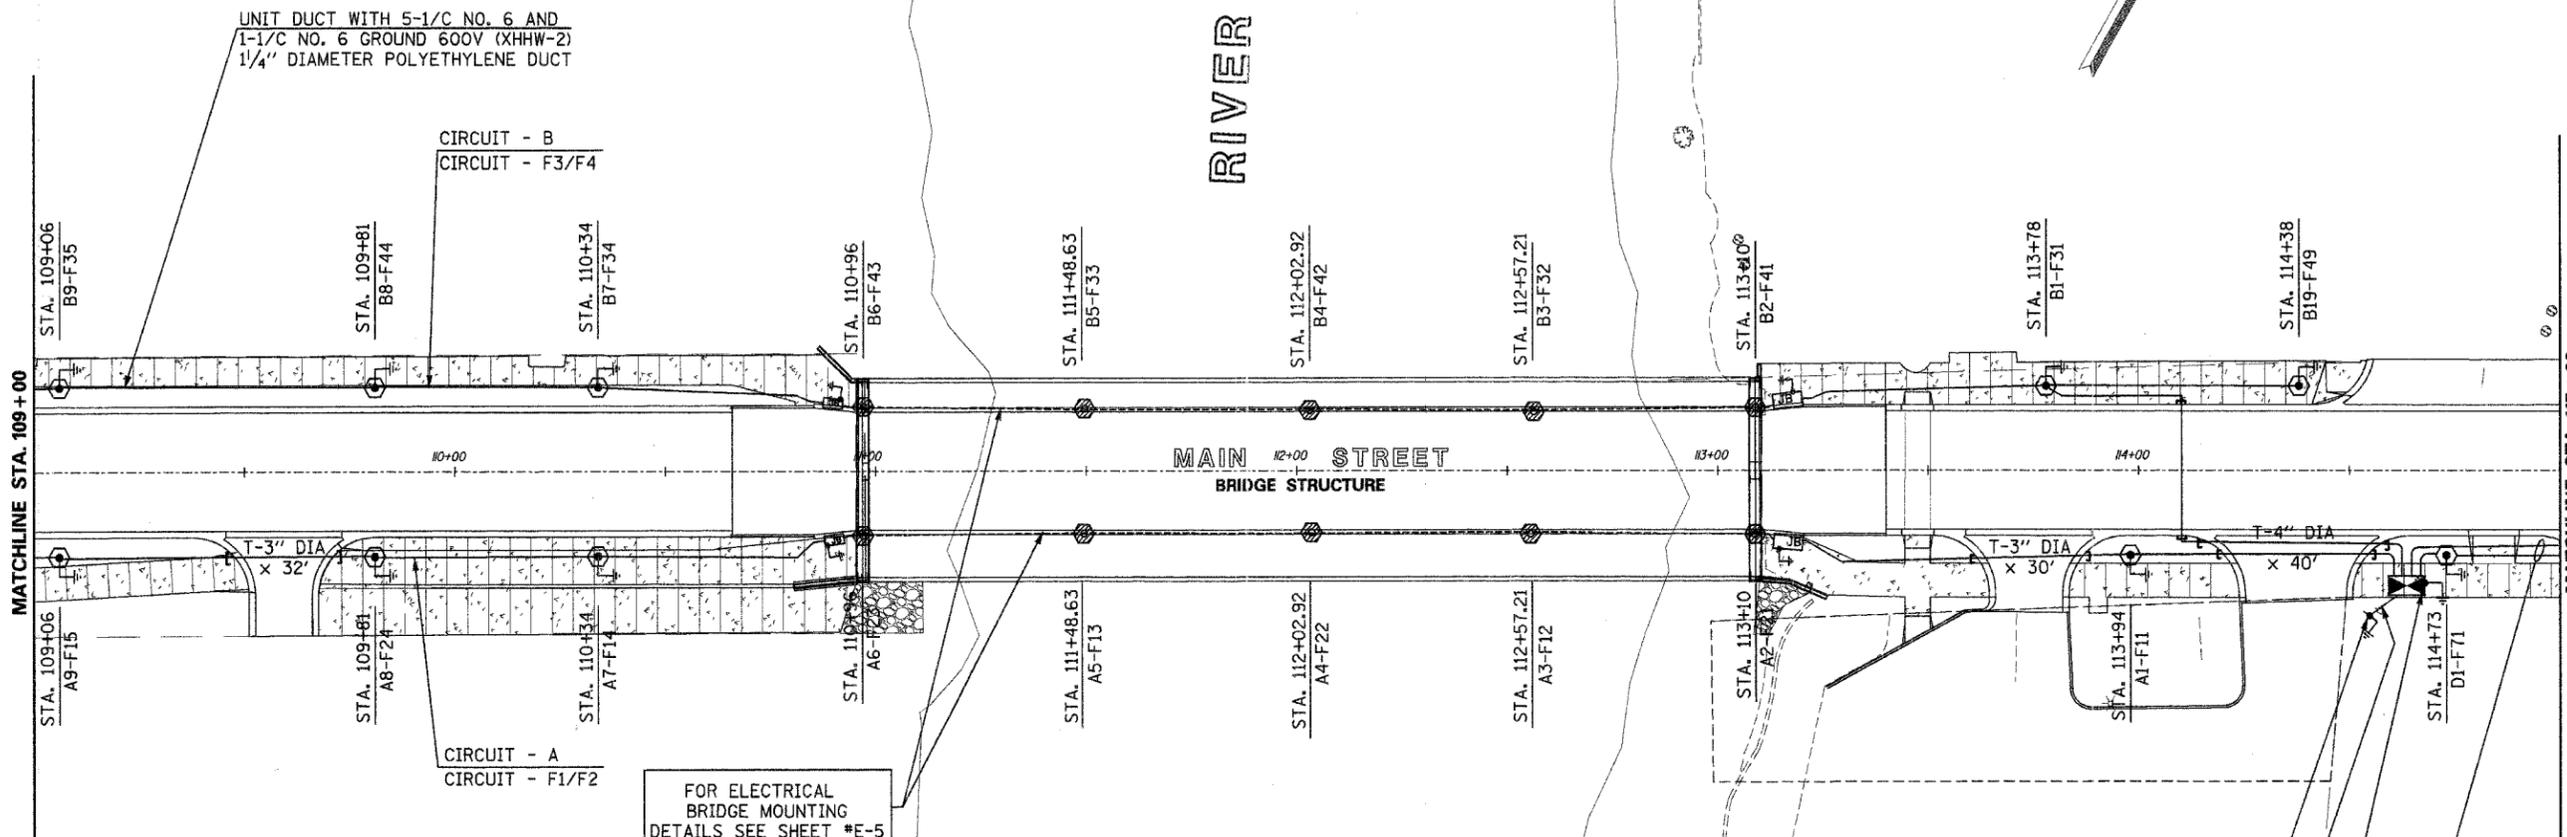


NOTE:

PROVIDE 8'-0" CLEARANCE BETWEEN THE FACE OF THE RETAINING WALL AND CENTER OF THE LIGHT POLE FOUNDATIONS AT STA.109+81 RT AND STA. 110+34 RT ONLY.

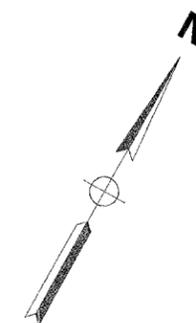

EXISTING LIGHTING REMOVAL DETAILS

NTS

CAUTION


"THE CONTRACTOR SHALL VERIFY THAT THERE ARE NO CONFLICTS BETWEEN THE PROPOSED LIGHT POLE FOUNDATION LOCATIONS AND EXISTING UTILITIES, PROPOSED UTILITIES, EXISTING DRIVEWAYS, AND PROPOSED DRIVEWAYS. IF A CONFLICT IS FOUND, THE CONTRACTOR SHALL IMMEDIATELY INFORM THE ENGINEER. IN THE EVENT OF A CONFLICT, THE CONTRACTOR SHALL OBTAIN WRITTEN INSTRUCTIONS FROM THE ENGINEER PRIOR TO PROCEEDING WITH ANY PART OF THE WORK AFFECTED. FAILING TO SECURE SUCH INSTRUCTIONS, THE CONTRACTOR WILL BE CONSIDERED TO HAVE PROCEEDED AT HIS OWN RISK AND EXPENSE."

UTILITY SERVICE, POLE MOUNTED
TRANSFORMER 120/240 VOLT,
1 PHASE, 3 WIRE - 50 KVA

ELECTRIC CABLE IN CONDUIT
600 (XLP - TYPE USE), 3 1/C NO. 3/0
2 1/2" DIA. CONDUIT IN TRENCH

LIGHTING CONTROLLER, SPECIAL
200 AMPERE - 120/240 VOLT,
1 PHASE, 3 WIRE

2 - UNIT DUCT WITH 5-1/C NO. 6 AND
1-1/C NO. 6 GROUND 600V (XHHW-2)
1 1/4" DIAMETER POLYETHYLENE DUCT



Sunjoy Inc.
Area Lighting
212 TIMBERCREST DRIVE
SCHAUMBURG, ILLINOIS
60193-1572

VILLAGE OF CARPENTERSVILLE
MAIN STREET OVER FOX RIVER
PROPOSED LIGHTING IMPROVEMENT
STA. 109+00 TO STA. 115+00

SCALE: 1"=20'
DATE: 02-05-05
DRAWN BY: HMO
CHECKED BY: JS